


Staffordshire Community Risk Register Matrix

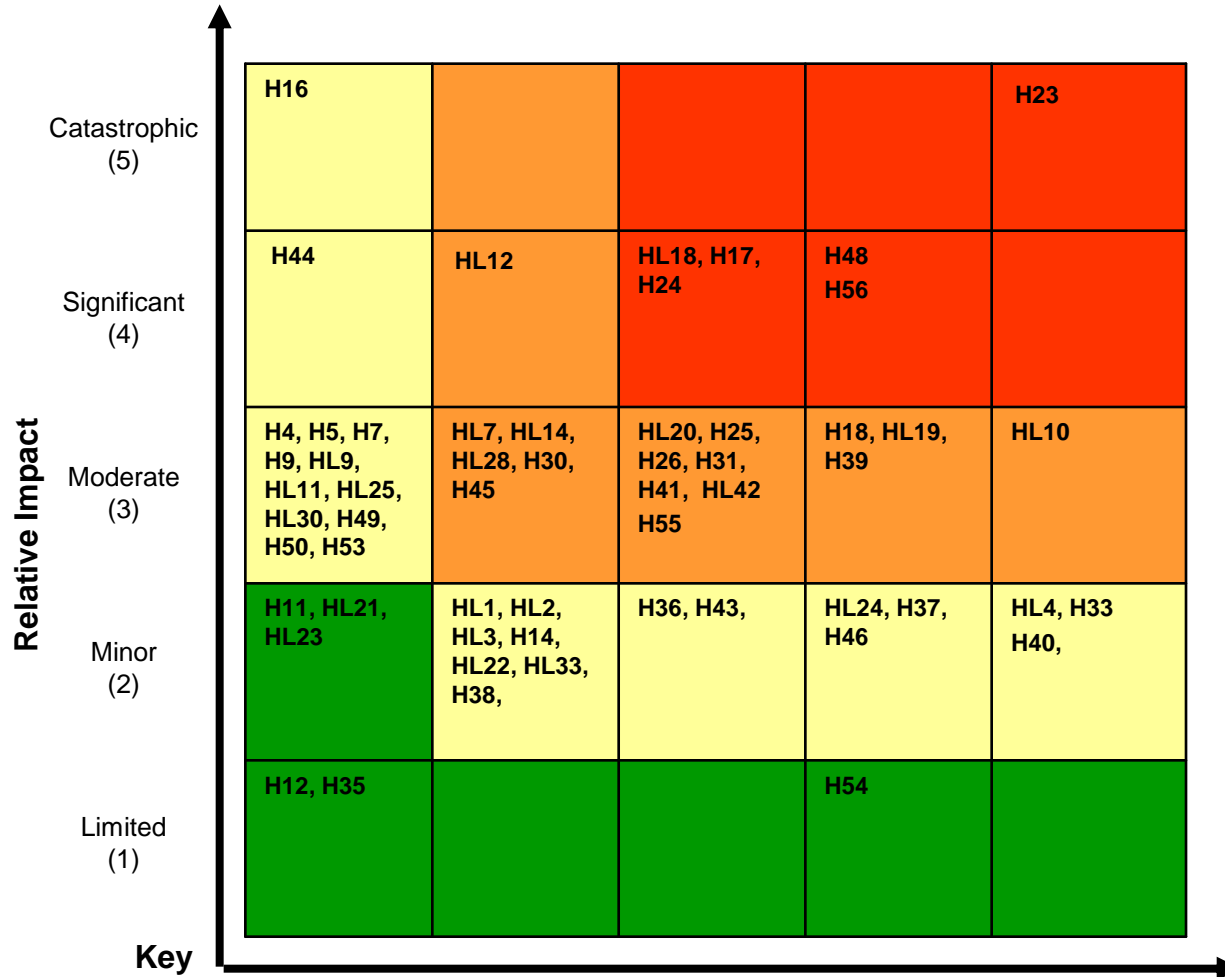

- Very High
- High
- Medium
- Low

- HL1 Fire or explosion – Gas Terminal / Pipeline
- HL2 Large Toxic Release
- HL3 Small Toxic Release
- H4 Fire or explosion – Fuel Distribution Site
- HL4 Pollution of Controlled Waters
- H5 Fire or Explosion at Onshore Fuel Pipeline
- H7 Explosion at High Pressure Gas Pipeline
- HL7 – Industrial Explosions & Major Fires
- H9 Large Toxic Chemical Release
- HL9 Aviation Accident
- HL10 Local Road Accident
- H11 Accidental Release of Radioactive Material
- HL11 Railway Accident
- H12 Biological Substance Release
- HL12 Transport of Hazardous Chemicals Incident
- H14 Major Contamination Incident
- HL14 Local Accident – Transport of Fuel / Explosives
- H16 Aviation Accident – Semi urban area
- H17 Storms & Gales**
- H18 Low Temperatures & Heavy Snow
- HL18 Local Urban Flooding**
- HL19 Local Fluvial Flooding
- HL20 Localised Flash Flooding
- HL21 Land Movements
- HL22 Building Collapse
- H23 Pandemic Type Disease**
- HL23 Bridge Collapse
- H24 Emerging Infectious Diseases**
- HL24 Legionella / Meningitis Outbreak
- H25 Non-zoonotic Notifiable Animal Disease
- HL25 Fire or explosion – Gas LPG / LNG Terminal
- H26 Zoonotic Notifiable Animal Disease
- HL28 Fire or explosion – Fuel Distribution Site
- H30 Industrial Action – Fire & Rescue Services
- HL30 Explosion at Gas Pipeline
- H31 Constraint on the Supply of Fuel
- H33 Prison Officer Strike
- HL33 Forest or Moorland Fires
- H35 Industrial Action – Key Rail or Underground Workers
- H36 International Disruption to Oil Supply
- H37 Influx of British Nationals – Security Incident
- H38 Technical Failure of Upstream Oil / Gas Network
- H39 Failure of Water Infrastructure
- H40 Loss of Telecommunications
- H41 Technical Failure of Electricity Network
- HL42 Industrial Action – Emergency & Critical Service Providers
- H43 Human Error – Telecommunication Infrastructure
- H44 Reservoir Dam Failure / Collapse
- H45 Technical Failure of Electricity Network
- H46 Biological Substance Release
- H48 Heat wave**
- H49 Loss of Drinking Water Supplies
- H50 Periodic Water Supply Interruptions
- H53 International Disruption to Gas Supply
- H54 International Disruption to Aviation (Volcanic Ash)
- H55 Severe Volcanic Activity
- H56 Severe Space Weather**